

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016

Received: 06/30/2016

Sampled By:

Work Order: Multiple Work Orders

C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:


Project # : -

PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-01	Sample Name: REN-1-DF-102 N Sampled: 6/13/16 13:05		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	7.1	ppb	2.0	20 ppb	08/17/16 15:50
6183004-02	Sample Name: REN-2-DF-211 N Sampled: 6/13/16 14:40		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	6.5	ppb	2.0	20 ppb	08/17/16 15:50
6183004-03	Sample Name: REN-2-DF-206 N Sampled: 6/13/16 14:45		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	8.9	ppb	2.0	20 ppb	08/17/16 15:50
6183004-04	Sample Name: AND-1-S-KITI Sampled: 6/13/16 15:03		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-05	Sample Name: AND-1-DF-106 N Sampled: 6/13/16 15:10		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-06	Sample Name: FRE-1-S-KITI Sampled: 6/13/16 15:32		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-07	Sample Name: FRE-1-DF-102 N Sampled: 6/13/16 15:36		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-08	Sample Name: FRE-2-DF-210 N Sampled: 6/13/16 15:41		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-09	Sample Name: FRE-3-DF-301 N Sampled: 6/13/16 15:50		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-10	Sample Name: HEW-1-S-KITI Sampled: 6/14/16 8:03		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50

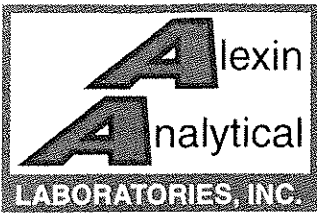

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016

Received: 06/30/2016

Sampled By:

Work Order: Multiple Work Orders

C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:


Project # : -

PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-11	Sample Name: HEW-1-DF-110 N Sampled: 6/14/16 8:10		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-12	Sample Name: HEW-2-DF-201 N Sampled: 6/14/16 8:16		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-13	Sample Name: LAR-1-DF-109 N Sampled: 6/14/16 8:37		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-14	Sample Name: LAR-1-S-KITI Sampled: 6/14/16 8:42		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	9.6	ppb	2.0	20 ppb	08/17/16 15:50
6183004-15	Sample Name: LAR-2-DF-208 N Sampled: 6/14/16 8:46		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-16	Sample Name: LAR-3-DF-308 N Sampled: 6/14/16 8:51		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-17	Sample Name: FOR-1-DF-MENN Sampled: 6/14/16 9:11		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-18	Sample Name: OBS-1-S Sampled: 6/14/16 9:19		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	5.2	ppb	2.0	20 ppb	08/17/16 15:50
6183004-19	Sample Name: FAC-1-DF-126 Sampled: 6/14/16 9:41		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-20	Sample Name: FAC-1-S-120 I Sampled: 6/14/16 9:45		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50

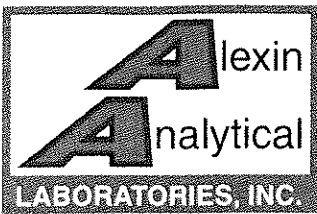

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016

Received: 06/30/2016

Sampled By:

Work Order: Multiple Work Orders

C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:


Project # : -

PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-21	Sample Name: FAC-1-S-133 N Sampled: 6/14/16 9:51		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-22	Sample Name: FAC-1-S-131 N Sampled: 6/14/16 10:21		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-23	Sample Name: FAC-1-S-119 I Sampled: 6/14/16 10:27		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-24	Sample Name: GRO-1-S-KITI Sampled: 6/14/16 11:18		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	2.9	ppb	2.0	20 ppb	08/17/16 15:50
6183004-25	Sample Name: JAN-0-S-KITI Sampled: 6/14/16 12:42		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-26	Sample Name: JAN-1-S-112 I Sampled: 6/14/16 12:48		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-27	Sample Name: JAN-1-S-109 I Sampled: 6/14/16 12:53		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-28	Sample Name: JAN-2-S-207 I Sampled: 6/14/16 13:03		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-29	Sample Name: JAN-2-S-201 I Sampled: 6/14/16 13:05		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	2.4	ppb	2.0	20 ppb	08/17/16 15:50
6183004-30	Sample Name: JAN-2-S-212 I Sampled: 6/14/16 13:08		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50

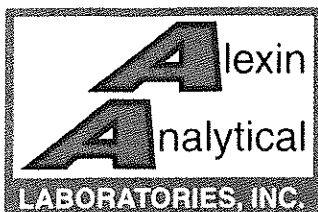

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-31	Sample Name: JAN-2-S-217 I Sampled: 6/14/16 13:12		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-32	Sample Name: GRO-1-S-104 I Sampled: 6/14/16 13:42		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-33	Sample Name: GRO-2-S-210 I Sampled: 6/14/16 13:47		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	4.9	ppb	2.0	20 ppb	08/17/16 15:50
6183004-34	Sample Name: GRO-2-S-202 I Sampled: 6/14/16 13:44		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-35	Sample Name: LAT-1-S-KITI Sampled: 6/14/16 14:31		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-36	Sample Name: WHI-1-S-KITI Sampled: 6/14/16 14:42		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-37	Sample Name: WHI-1-DF-114 N Sampled: 6/14/16 14:49		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-38	Sample Name: WHI-2-DF-201 N Sampled: 6/14/16 14:55		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-39	Sample Name: MIL-3-DF-311 N Sampled: 6/15/16 8:07		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-40	Sample Name: MIL-1-S-KITI Sampled: 6/15/16 8:17		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50

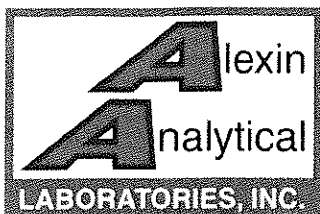

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-41	Sample Name: MIL-1-DF-107 N Sampled: 6/15/16 8:20		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-42	Sample Name: MIL-0-DF-REST N Sampled: 6/15/16 8:28		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-43	Sample Name: MIL-0-S-ALP N Sampled: 6/15/16 8:40		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-44	Sample Name: MIL-0-S-ZET N Sampled: 6/15/16 8:47		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-45	Sample Name: MIL-0-S-DEL N Sampled: 6/15/16 8:53		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-46	Sample Name: MIL-0-S-SIG N Sampled: 6/15/16 8:58		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-47	Sample Name: WHI-3-DF-301 N Sampled: 6/15/16 9:20		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-48	Sample Name: PIO-4-S-KITI Sampled: 6/15/16 9:35		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	5.0	ppb	2.0	20 ppb	08/17/16 15:50
6183004-49	Sample Name: PIO-2-S-203 N Sampled: 6/15/16 9:40		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	3.9	ppb	2.0	20 ppb	08/17/16 15:50
6183004-50	Sample Name: POTR-1-S-KITI Sampled: 6/15/16 10:27		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50

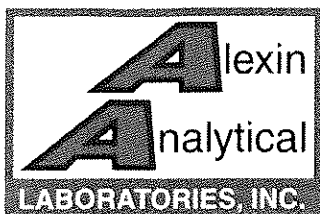

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-51	Sample Name: POTA-1-DF-113 N Sampled: 6/15/16 10:39		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	69.6	ppb	4.0	20 ppb	08/17/16 15:50 MCLE
6183004-52	Sample Name: POTA-1-S-112 N Sampled: 6/15/16 10:44		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	11.2	ppb	2.0	20 ppb	08/17/16 15:50
6183004-53	Sample Name: POTA-2-DF-224 N Sampled: 6/15/16 10:49		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	32.8	ppb	2.0	20 ppb	08/17/16 15:50 MCLE
6183004-54	Sample Name: POTA-3-DF-336 N Sampled: 6/15/16 10:54		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	74.7	ppb	4.0	20 ppb	08/17/16 15:50 MCLE
6183004-55	Sample Name: POTA-0-DF-011 N Sampled: 6/15/16 10:57		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	17.6	ppb	2.0	20 ppb	08/17/16 15:50
6183004-56	Sample Name: MAH-1-S-KITI Sampled: 6/15/16 12:46		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-57	Sample Name: MAH-1-DF-119 N Sampled: 6/15/16 12:53		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-58	Sample Name: MAH-1-DF-103 N Sampled: 6/15/16 12:58		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-59	Sample Name: MAH-3-DF-319 N Sampled: 6/15/16 13:07		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50
6183004-60	Sample Name: MAH-3-DF-303 N Sampled: 6/15/16 13:12		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/17/16 15:50

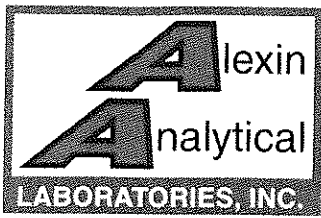

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016

Received: 06/30/2016

Sampled By:

Work Order: Multiple Work Orders

**C
L
I
E
N
T**
Linfield College
Attn: Rebecca Wale
900 SE Baker St
McMinnville OR, 97128
Phone: (503) 883-2431

Project:


Project # : -

PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-61							Matrix: Drinking Water
	Sample Name: MAH-2-DF-203 N						
	Sampled: 6/15/16 13:17						
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-62							Matrix: Drinking Water
	Sample Name: MAH-2-DF-223 N						
	Sampled: 6/15/16 13:19						
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-63							Matrix: Drinking Water
	Sample Name: MEM-1-S-KITI						
	Sampled: 6/15/16 13:44						
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-64							Matrix: Drinking Water
	Sample Name: MEM-1-DF-101 N						
	Sampled: 6/15/16 13:46						
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-65							Matrix: Drinking Water
	Sample Name: MEM-2-DF-213 N						
	Sampled: 6/15/16 13:51						
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-66							Matrix: Drinking Water
	Sample Name: DAN-2-S-23 I						
	Sampled: 6/15/16 14:25						
+Lead	1030	EPA 200.9	15.5	ppb	2.0	20 ppb	08/18/16 17:23
6183004-67							Matrix: Drinking Water
	Sample Name: DAN-2-S-24 I						
	Sampled: 6/15/16 14:32						
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-68							Matrix: Drinking Water
	Sample Name: DAN-2-S-21 I						
	Sampled: 6/15/16 14:34						
+Lead	1030	EPA 200.9	7.4	ppb	2.0	20 ppb	08/18/16 17:23
6183004-69							Matrix: Drinking Water
	Sample Name: DAN-2-S-22 I						
	Sampled: 6/15/16 14:36						
+Lead	1030	EPA 200.9	3.3	ppb	2.0	20 ppb	08/18/16 17:23
6183004-70							Matrix: Drinking Water
	Sample Name: DAN-1-S-3 I						
	Sampled: 6/15/16 14:47						
+Lead	1030	EPA 200.9	23.5	ppb	2.0	20 ppb	08/18/16 17:23 MCL

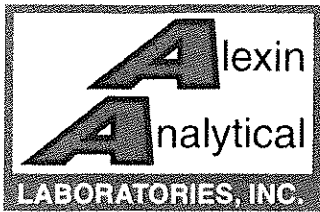

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-71	Sample Name: DAN-1-S-4 I Sampled: 6/15/16 14:49		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-72	Sample Name: DAN-1-S-1 I Sampled: 6/15/16 14:53		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	2.0	ppb	2.0	20 ppb	08/18/16 17:23
6183004-73	Sample Name: DAN-1-S-2 I Sampled: 6/15/16 14:55		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-74	Sample Name: LEG-1-S-1 I Sampled: 6/16/16 3:30		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-75	Sample Name: LEG-1-S-2 I Sampled: 6/16/16 3:32		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-76	Sample Name: LEG-1-S-3 I Sampled: 6/16/16 3:34		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-77	Sample Name: LEG-1-S-4 I Sampled: 6/16/16 3:36		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-78	Sample Name: LEG-1-S-5 I Sampled: 6/16/16 3:38		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-79	Sample Name: LEG-1-S-6 I Sampled: 6/16/16 3:40		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23
6183004-80	Sample Name: HHP-2-DF-204 N Sampled: 6/16/16 10:51		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/18/16 17:23

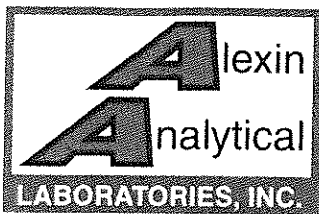

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-81	Sample Name: HHP-1-DF-112 N Sampled: 6/16/16 10:56		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-82	Sample Name: HHP-0-DF-020 I Sampled: 6/16/16 11:22		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-83	Sample Name: HHP-0-DF-040 I Sampled: 6/16/16 11:30		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-84	Sample Name: HHP-0-DF-050 N Sampled: 6/16/16 11:35		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-85	Sample Name: HHP-0-DF-074 N Sampled: 6/16/16 11:40		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-86	Sample Name: HHP-0-DF-011 N Sampled: 6/16/16 12:49		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-87	Sample Name: HHP-0-DF-013 I Sampled: 6/16/16 12:52		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-88	Sample Name: HHP-1-S-109 I Sampled: 6/16/16 14:13		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-89	Sample Name: 1406-1-S-KITI Sampled: 6/16/16 14:25		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	2.0	ppb	2.0	20 ppb	08/19/16 16:34
6183004-90	Sample Name: TAY-2-DF-207 N Sampled: 6/16/16 8:16		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	6.6	ppb	2.0	20 ppb	08/19/16 16:34

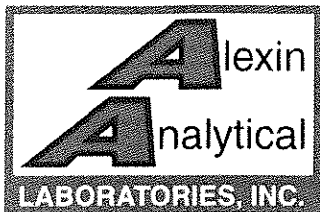

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183004-91	Sample Name: TAY-1-DF-103 N Sampled: 6/16/16 8:20		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	2.9	ppb	2.0	20 ppb	08/19/16 16:34
6183004-92	Sample Name: TAY-2-S-206 I Sampled: 6/16/16 8:31		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	8.0	ppb	2.0	20 ppb	08/19/16 16:34
6183004-93	Sample Name: MEL-0-DF-009 N Sampled: 6/16/16 8:39		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-94	Sample Name: MEL-0-S-006 N Sampled: 6/16/16 8:45		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-95	Sample Name: MEL-1-DF-102 N Sampled: 6/16/16 8:49		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-96	Sample Name: MEL-1-S-114 I Sampled: 6/16/16 8:56		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-97	Sample Name: MEL-2-DF-202 N Sampled: 6/16/16 9:10		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-98	Sample Name: JFM-1-DF-102 N Sampled: 6/16/16 9:50		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183004-99	Sample Name: HHP-2-S-212 I Sampled: 6/16/16 10:49		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183008-01	Sample Name: RIL-3-DF-308 N Sampled: 6/22/16 15:41		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44

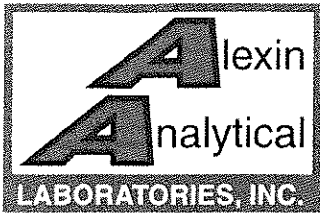

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016

Received: 06/30/2016

Sampled By:

Work Order: Multiple Work Orders

C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:


Project # : -

PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183008-02	Sample Name: RIL-2-DF-218 N Sampled: 6/22/16 15:42		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-03	Sample Name: RIL-2-S-208 I Sampled: 6/22/16 15:43		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-04	Sample Name: NIC-1-S-113 N Sampled: 6/22/16 16:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-05	Sample Name: NIC-1-S-177 I Sampled: 6/22/16 16:01		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-06	Sample Name: NIC-1-DF-126 N Sampled: 6/22/16 16:02		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-07	Sample Name: 124S-1-S-KITI Sampled: 6/23/16 13:08		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-08	Sample Name: NIC-1-S-144 I Sampled: 6/23/16 10:51		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-09	Sample Name: LEG-1-S-20 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-10	Sample Name: LEG-1-S-21 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-11	Sample Name: GRE-1-S-1 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	6.5	ppb	2.0	20 ppb	08/05/16 15:44

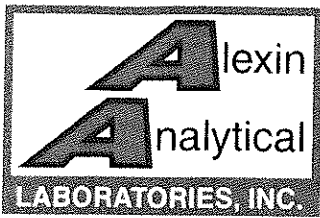

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016

Received: 06/30/2016

Sampled By:

Work Order: Multiple Work Orders

C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:


Project # : -

PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183008-12	Sample Name: GRE-1-S-2 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-13	Sample Name: GRE-1-S-3 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-14	Sample Name: GRE-1-S-4 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-15	Sample Name: GRE-1-S-5 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-16	Sample Name: GRE-1-S-6 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-17	Sample Name: GRE-1-S-7 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-18	Sample Name: GRE-1-S-8 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-19	Sample Name: GRE-1-S-9 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-20	Sample Name: GRE-1-S-10 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-21	Sample Name: GRE-1-S-11 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44

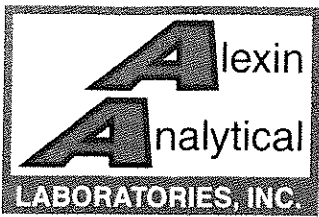

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


**C
L
I
E
N
T**
Linfield College
Attn: Rebecca Wale
900 SE Baker St
McMinnville OR, 97128
Phone: (503) 883-2431

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183008-22	Sample Name: GRE-1-S-12 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-23	Sample Name: GRE-1-S-13 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-24	Sample Name: LEG-1-S-13 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-25	Sample Name: LEG-1-S-14 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-26	Sample Name: LEG-1-S-15 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-27	Sample Name: LEG-1-S-16 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-28	Sample Name: LEG-1-S-17 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-29	Sample Name: LEG-1-S-18 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-30	Sample Name: LEG-1-S-19 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-31	Sample Name: WHIT-1-S-1 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07

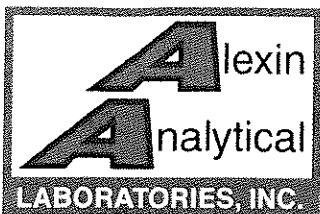

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183008-32	Sample Name: WHIT-1-S-2 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-33	Sample Name: WHIT-1-S-3 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-34	Sample Name: WHIT-1-S-4 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-35	Sample Name: WHIT-1-S-5 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-36	Sample Name: WHIT-1-S-6 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-37	Sample Name: WHIT-1-S-7 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-38	Sample Name: WHIT-1-S-8 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-39	Sample Name: WHIT-1-S-9 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-40	Sample Name: WHIT-1-S-10 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-41	Sample Name: WHIT-1-S-11 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07

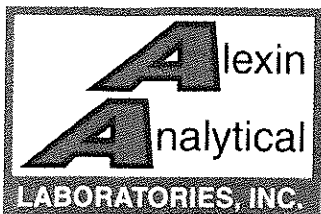

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183008-42	Sample Name: WHIT-1-S-12 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-43	Sample Name: WHIT-1-S-13 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-44	Sample Name: WHIT-1-S-14 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-46	Sample Name: WHIT-1-S-16 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/04/16 17:07
6183008-48	Sample Name: WHIT-1-S-18 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-49	Sample Name: WHIT-1-S-19 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-50	Sample Name: WHIT-1-S-20 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-51	Sample Name: WHIT-1-S-21 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-53	Sample Name: GRE-1-S-14 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-54	Sample Name: NEW-1-S-1 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44

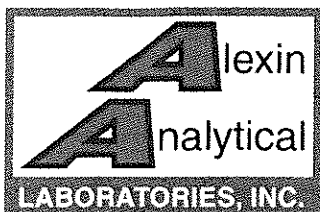

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183008-55	Sample Name: NEW-1-S-2 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-56	Sample Name: NEW-1-S-3 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-57	Sample Name: NEW-1-S-4 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-58	Sample Name: NEW-1-S-5 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-59	Sample Name: NEW-1-S-6 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	3.3	ppb	2.0	20 ppb	08/05/16 15:44
6183008-60	Sample Name: NEW-1-S-7 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-61	Sample Name: RED-1-S-1 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-62	Sample Name: RED-1-S-2 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-63	Sample Name: RED-1-S-3 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-64	Sample Name: RED-1-S-4 I Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44

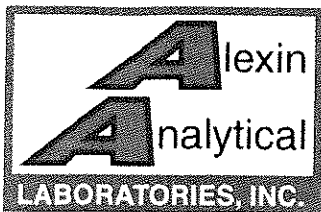

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183008-65	Sample Name: EMM-1-S-KITI Sampled: 6/23/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-66	Sample Name: 1149-1-S-KITI Sampled: 6/28/16 12:54		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-67	Sample Name: 1147-1-S-KITI Sampled: 6/28/16 13:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-68	Sample Name: 1139-1-S-KITI Sampled: 6/28/16 13:05		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	2.2	ppb	2.0	20 ppb	08/05/16 15:44
6183008-69	Sample Name: 1125-1-S-KITI Sampled: 6/28/16 13:11		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-70	Sample Name: 1220-1-S-KITI Sampled: 6/28/16 13:27		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-71	Sample Name: HEW-1-S-116 I Sampled: 6/28/16 13:33		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-72	Sample Name: MIL-1-S-110 I Sampled: 6/28/16 0:00		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-73	Sample Name: LEG-1-S-7 I Sampled: 6/21/16 13:11		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-74	Sample Name: LEG-1-S-8 I Sampled: 6/21/16 13:14		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44

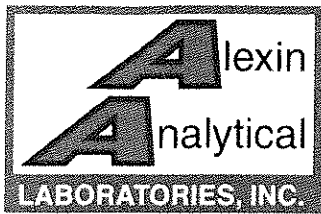

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016

Received: 06/30/2016

Sampled By:

Work Order: Multiple Work Orders

C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:


Project # : -

PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183008-75	Sample Name: LEG-1-S-9 I Sampled: 6/21/16 13:17		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-76	Sample Name: LEG-1-S-10 I Sampled: 6/21/16 13:20		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-77	Sample Name: LEG-1-S-11 I Sampled: 6/21/16 13:25		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-78	Sample Name: LEG-1-S-12 I Sampled: 6/21/16 13:30		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-79	Sample Name: COO-1-S-107 I Sampled: 6/21/16 13:50		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-80	Sample Name: COZ-0-DF-RR N Sampled: 6/21/16 14:03		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	7.1	ppb	2.0	20 ppb	08/05/16 15:44
6183008-81	Sample Name: FIE-1-DF-RR N Sampled: 6/21/16 14:10		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-82	Sample Name: GRA-0-DF-15 N Sampled: 6/21/16 15:35		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	4.5	ppb	2.0	20 ppb	08/05/16 15:44
6183008-83	Sample Name: GRA-1-S-110 I Sampled: 6/21/16 15:40		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44
6183008-84	Sample Name: GRA-2-DF-207 N Sampled: 6/21/16 15:45		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44

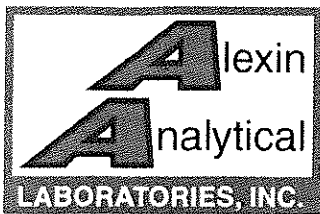

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders


C
L
I
E
N
T

Linfield College
Attn: Rebecca Wale
900 SE Baker St
McMinnville OR, 97128
Phone: (503) 883-2431

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time	
6183008-85	Sample Name: MAC-1-DF-103 N Sampled: 6/22/16 12:43							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44	
6183008-86	Sample Name: MUR-1-DF-109 N Sampled: 6/22/16 12:48							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44	
6183008-87	Sample Name: MUR-2-DF-227 N Sampled: 6/22/16 12:52							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44	
6183008-88	Sample Name: MUR-2-S-216 N Sampled: 6/22/16 12:57							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44	
6183008-89	Sample Name: UPW-1-S-KITI Sampled: 6/22/16 13:02							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44	
6183008-90	Sample Name: MAL-1-S-RR N Sampled: 6/22/16 13:12							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44	
6183008-91	Sample Name: PRE-1-S-KITI Sampled: 6/22/16 13:32							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44	
6183008-92	Sample Name: PRE-1-S-CKITI Sampled: 6/22/16 13:34							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/05/16 15:44	
6183011-01	Sample Name: WAL-1-S-125 N Sampled: 6/22/16 14:07							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34	
6183011-02	Sample Name: WAL-1-S-104 I Sampled: 6/22/16 14:14							Matrix: Drinking Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34	

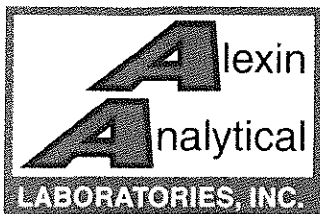

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders

**C
L
I
E
N
T**


Linfield College
Attn: Rebecca Wale
900 SE Baker St
McMinnville OR, 97128
Phone: (503) 883-2431

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183011-03	Sample Name: WAL-1-DF-RR N Sampled: 6/22/16 14:18		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-04	Sample Name: WAL-3-DF-305 N Sampled: 6/22/16 14:24		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-05	Sample Name: WAL-2-DF-203 N Sampled: 6/22/16 14:26		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-06	Sample Name: MAL-1-S-2 N Sampled: 6/22/16 14:35		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-07	Sample Name: MAL-1-S-3 N Sampled: 6/22/16 14:40		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-08	Sample Name: REN-1-DF-104 N Sampled: 6/22/16 15:18		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	6.0	ppb	2.0	20 ppb	08/19/16 16:34
6183011-09	Sample Name: RIL-1-S-109 I Sampled: 6/22/16 15:30		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-10	Sample Name: RIL-1-DF-110 N Sampled: 6/22/16 15:40		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-11	Sample Name: PET-1-DF-110 N Sampled: 6/30/16 14:38		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-12	Sample Name: PET-1-S-101 B Sampled: 6/30/16 14:41		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34

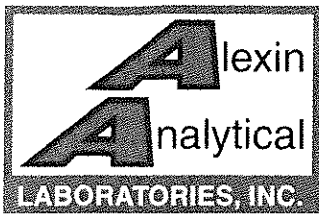

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016
Received: 06/30/2016
Sampled By:
Work Order: Multiple Work Orders

C
L
I
E
N
T

Linfield College
Attn: Rebecca Wale
900 SE Baker St
McMinnville OR, 97128
Phone: (503) 883-2431

Project:
Project # : -
PWSID # :

Sampling Location: Linfield College

Lab Number


Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
6183011-13	Sample Name: PET-3-S-KITI Sampled: 6/30/16 14:50		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-14	Sample Name: LOV-1-S-KITI Sampled: 6/30/16 15:05		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-15	Sample Name: LOV-4-S-KITI Sampled: 6/30/16 15:10		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-16	Sample Name: LOV-5-S-KITI Sampled: 6/30/16 15:11		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-17	Sample Name: LOV-6-S-KITI Sampled: 6/30/16 15:13		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-18	Sample Name: LOV-7-S-KITI Sampled: 6/30/16 15:15		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-19	Sample Name: LOV-8-S-KITI Sampled: 6/30/16 15:18		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34
6183011-20	Sample Name: LOV-9-S-KITI Sampled: 6/30/16 15:20		Matrix: Drinking Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	08/19/16 16:34

MCLE This analyte exceeds the MCL limit.

ND = None detected at the MRL **MRL** = Minimum Reporting Limit

MCL = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

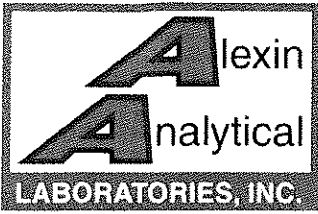

Professional Laboratory Services

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 08/22/2016

Received: 06/30/2016

Sampled By:

Work Order: Multiple Work Orders

C Linfield College
L Attn: Rebecca Wale
I 900 SE Baker St
E McMinnville OR, 97128
N Phone: (503) 883-2431
T

Project:

Project # : -

PWSID # :

Sampling Location: Linfield College

Lab Number

* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: _____


Adriana Gonzalez-Gray
Laboratory Director